

REMSI Sketches 51-100 Sketch #58a 6-52

0000-000-ST-6052 Custom ID: DCS 6-52

Revision: 09


Effective Date: 7/10/2023

Page 32 of 84

Sketch #58a Inverter-based renewable generation for DG capacity over 20% of the load center bus bar rating for CT cabinet/secondary metering installations

Voltage/ Phase:	Amperage:	Inverter Continuous Current
1 phase, 3 wire Network 120/208V*	N/A	N/A
3 phase, 4 wire WYE 120/208V		
3 phase, 4 wire Delta 120/240V		
3 phase, 4 wire WYE 277/480V		
3 wire, 3 phase Delta 480V		
Service Type:	Meter Type/Location:	Bus Bar Rating:
Overhead/Underground	Self-contained/Outdoor	ANY

^{*} The maximum parallel connection (generation) permitted on a single-phase installation is 150 kW.

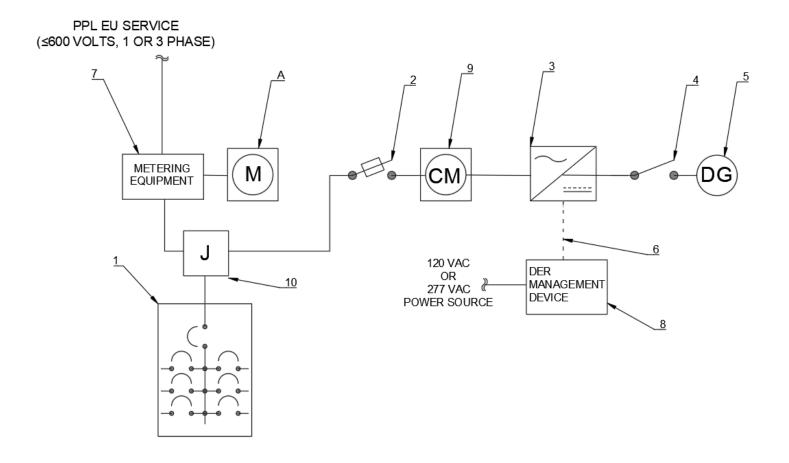

EMSI S058AP1.dwg

RULES FOR ELECTRIC METER AND SERVICE INSTALLATIONS

PPL ELECTRIC UTILITIES CORPORATION

Rules: 2,12, 28

Date: 07/10/2023 Engr: JEU

© 2021 PPL Electric Utilities Corporation. All rights reserved



REMSI Sketches 51-100 Sketch #58a 6-52

0000-000-ST-6052 Custom ID: DCS 6-52

Revision: 09

Effective Date: 7/10/2023

Page 33 of 84

Sketch #58a (cont.) Inverter-based renewable generation for DG capacity over 20% of the load center bus bar rating for CT cabinet/secondary metering installations (cont.)

CUSTOMER FURNISHES, INSTALLS, MAINTAINS:

- 1. Load center
- 2. AC disconnect (fused)
- 3. Inverter(s) (includes metering and communication features) inverter shall be labeled as IEEE 1547/UL 1741 listed.
- 4. DC disconnect
- 5. Distributed Generator (DG) source
- 7. CT cabinet (may include potential transformer if required).
- 9. Customer meter (optional)
- 10. Point of interconnection shall be made within a service entrance rated enclosure, such as a junction box, new or existing customer distribution equipment, etc. Customer equipment/conductors are not permitted within utility sealed sections (REMSI Rule 12). Conductor taps shall be made using UL-listed tap connectors.

PPL EU FURNISHES, MAINTAINS:

- 6. Wired communication between PPL DER Management Device and inverter.
- 8. PPL communication device to PPL network.

REMSI S058AP1.dwg

RULES FOR ELECTRIC METER AND SERVICE INSTALLATIONS

PPL ELECTRIC UTILITIES CORPORATION

Rules: 2,12, 28

Date: 07/10/2023 Engr: JEU



REMSI Sketches 51-100 Sketch #58a 6-52

0000-000-ST-6052 Custom ID: DCS 6-52

Revision: 09

Effective Date: 7/10/2023

Page 34 of 84

Sketch #58a (cont.) Inverter-based renewable generation for DG capacity over 20% of the load center bus bar rating for CT cabinet/secondary metering installations (cont.) NOTES:

- A. Metering equipment. See appropriate sketch for service type and size to determine metering responsibilities.
- B. See PPL ER customer-owned generation website for more information.
- C. Application for customer-owned, inverter-based renewable generation must be completed. See customer-owned generation applications.
- D. PPL EU requires an independent electrical inspection. The inspector is required to verify the IEEE/UL listing of the inverter.
- E. Installation must adhere to requirements of National Electrical Code (NEC) article 690 and article 705.
- F. All labeling must be in accordance with NEC article 690.
- G. In addition to Note D, PPL EU will install permanent labeling on the meter base PPL EU catalog (CID 1012171) and pad mount transformer (CID 1012171) or pole mount transformer (CID 1013816) upon receipt of inspection.
- H. Metering equipment. See appropriate sketch for service type and size to determine metering responsibilities.
- I. If a neutral connection exists at the inverter, the inverter neutral shall beconnected to the service neutral.
- J. If inverter output voltage > 480vac, customer shall provide transformation to match PPL service voltage.
- K. If inverter output voltage > 480vac, customer shall provide external power source for PPL owned DER management device.
- L. Customer shall contact PPL EU prior to any new installations depicted in this sketch.
- M. PPL requires a local RS-485 or ethernet communication interface, also referred to as a communication port, to be open and accessible for the company owned DER management device (IEEE 1547-2018, sec. 10.1,4).
- N. Installations with multiple inverters shall be networked together by the customer per manufacturer guidelines or RS-485 multidrop networking. A communication network diagram depicting port availability and networking design shall be included with the system's interconnection application.
- O. For inverters where an additional module or kit is required to make the communication interface/port available, the module or kit must be included as part of the installed system. Reference PPL's approved solar inverter list for specific information.
- P. In the event of an outage or interruption due to equipment failure, weather, etc., any connected DER systems may be temporarily interrupted during the service restoration process.

REMSI_S058AP1.dwg

RULES FOR ELECTRIC METER AND SERVICE INSTALLATIONS

PPL ELECTRIC UTILITIES CORPORATION

Rules: 2,12, 28

Date: 07/10/2023 Engr: JEU