




**NOT FOR NEW CONSTRUCTION**

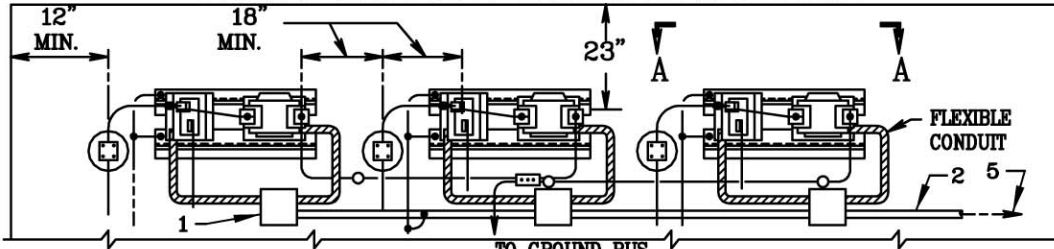

ARRANGEMENT OF EQUIPMENT WHEN OUTDOOR  
TYPE INSTRUMENT TRANSFORMERS ARE INSTALLED

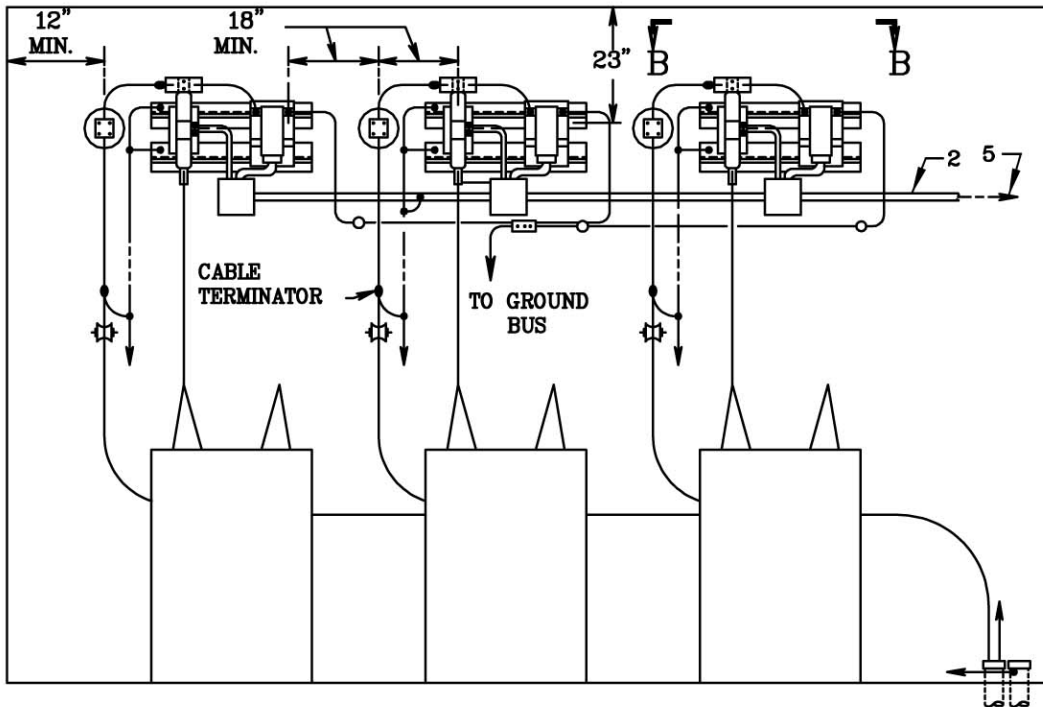

ARRANGEMENT OF EQUIPMENT WHEN INDOOR  
TYPE INSTRUMENT TRANSFORMERS ARE INSTALLED

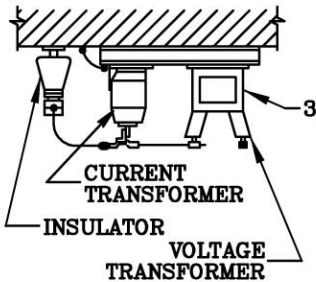

SECTIONAL PLAN A-A

CUSTOMER FURNISHES, INSTALLS, MAINTAINS:


- 1 - 8 INCH BY 8 INCH BY 4 INCH WEATHER TIGHT JUNCTION BOX
- 2 - 1-1/4 INCH MINIMUM THREADED, GALVANIZED, RIGID OR SCHEDULE 40 PVC CONDUIT AND FITTINGS BETWEEN 8 INCH BY 8 INCH BY 4 INCH WEATHER TIGHT JUNCTION BOX AND METER PANEL.

PPL FURNISHES, MAINTAINS: CUSTOMER INSTALLS:

- 3 - INSTRUMENT TRANSFORMERS AND MOUNTING STEEL
- 4 - METER PANEL AT A LOCATION OUTSIDE OF TRANSFORMER ENCLOSURE (NOT SHOWN). SEE SKETCH 8C.

PPL FURNISHES, INSTALLS, MAINTAINS:

- 5 - WIRING BETWEEN INSTRUMENT TRANSFORMERS AND METER PANEL (SEE RULE 18).

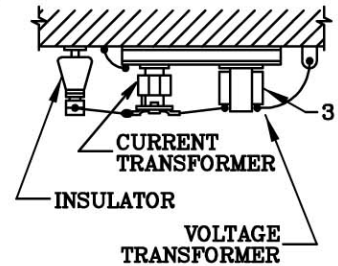

SECTIONAL PLAN B-B