



**REMSI Sketches 51-100**  
**Sketch #56a**  
**6-52**

0000-000-ST-6052  
 Custom ID: DCS 6-52  
 Revision: 06  
 Effective Date: 10/11/2021  
 Page 22 of 90


**Sketch #56a Inverter-based renewable generation for up to and including 20% of the load center bus bar rating for meter base size ≤ 200 amps. for ≤ 240V installations.**

<u>Voltage/ Phase:</u> 1 phase, 3 wire Network 120/208V* 1 phase, 3 wire 120/240V*	<u>Amperage:</u> ≤ 200 Amps maximum	<u>Inverter Continuous Current</u> N/A
<u>Service Type:</u> Overhead/Underground	<u>Meter Type/Location:</u> Self-contained/Outdoor	<u>Bus Bar Rating:</u> ≤20%

\* The maximum parallel connection (generation) permitted on a single-phase installation is 150 kW.

**DER SYSTEM WITH TOTAL SYSTEM INVERTER CONTINUOUS CURRENT LESS THAN OR EQUAL TO 20% OF LOAD CENTER BUS BAR RATING**

**PPL EU SERVICE**  
 (≤240 VOLTS, ≤200 AMPS, 1 PHASE)

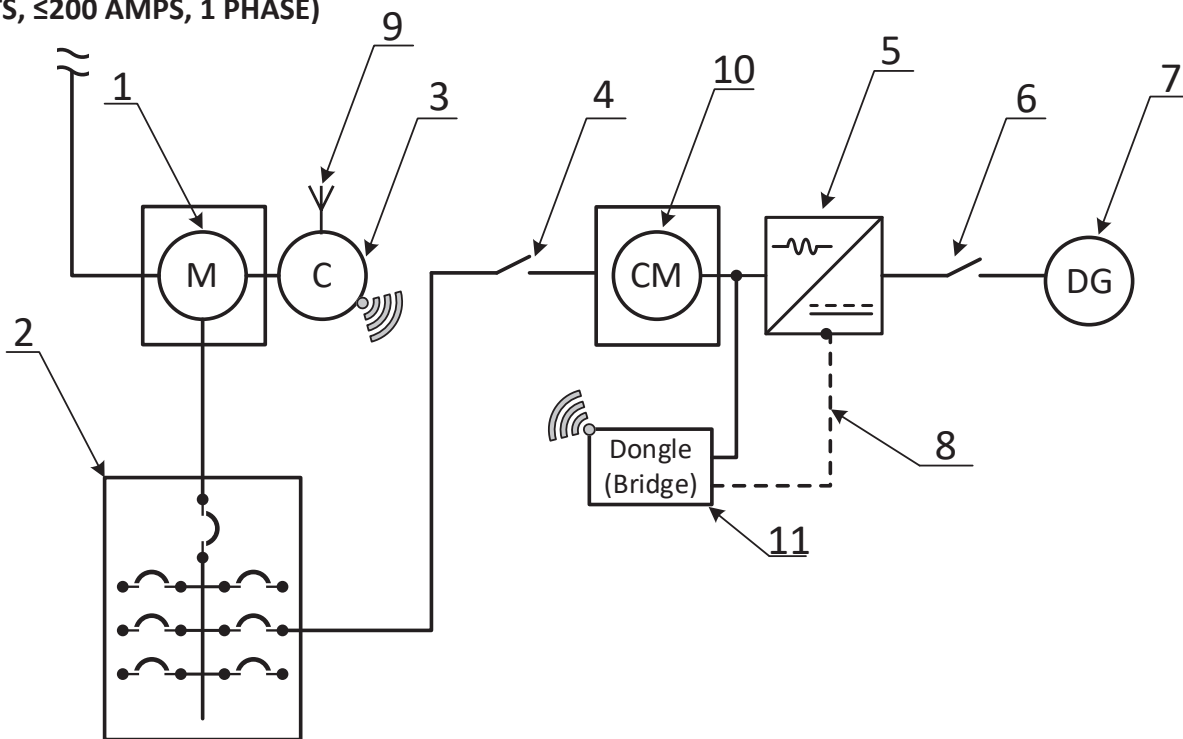

REMSI\_S056a.dwg

RULES FOR ELECTRIC METER AND SERVICE INSTALLATIONS <b>PPL ELECTRIC UTILITIES CORPORATION</b>	<b>Rules:</b> 12, 28 <b>Date:</b> 10/11/2021 Engr: NHK
---	---



**REMSI Sketches 51-100**  
**Sketch #56a**  
**6-52**

0000-000-ST-6052  
Custom ID: DCS 6-52  
Revision: 06  
Effective Date: 10/11/2021  
Page 23 of 90

**Sketch #56a (cont.) Inverter-based renewable generation for up to and including 20% of the load center bus bar rating for meter base size  $\leq$  200 amps, for  $\leq$  240V installations**

**CUSTOMER FURNISHES, INSTALLS, MAINTAINS:**

2. LOAD CENTER
4. AC DISCONNECT SWITCH
5. INVERTER(S) (INCLUDES METERING AND COMMUNICATION FEATURES). INVERTER SHALL BE LABELED AS IEEE 1547/UL 1741 LISTED.
6. DC DISCONNECT
7. DISTRIBUTED GENERATION (DG) SOURCE
10. CUSTOMER'S METERING (OPTIONAL)
11. SERVICE ENTRANCE RATED JUNCTION BOX

**PPL EU FURNISHES, INSTALLS, MAINTAINS:**

1. UTILITY METER
3. PPL METER COLLAR WITH CIRCUIT BREAKER
8. WIRED COMMUNICATION TRANSMISSION BETWEEN PPL DONGLE AND INVERTER (FOR PPL METER COLLAR)
9. COMMUNICATION TRANSMISSION BETWEEN PPL METER COLLAR AND AMI/PPL EU (FOR PPL METER COLLAR)
11. PPL WIFI COMMUNICATION DONGLE (BRIDGE) TO PPL METER COLLAR.

REMSI\_S056a.dwg

RULES FOR ELECTRIC METER AND SERVICE  
INSTALLATIONS  
**PPL ELECTRIC UTILITIES CORPORATION**

**Rules:** 12, 28  
**Date:** 10/11/2021 Engr: NHK



REMSI Sketches 51-100  
Sketch #56a  
6-52

0000-000-ST-6052  
Custom ID: DCS 6-52  
Revision: 06  
Effective Date: 10/11/2021  
Page 24 of 90

**Sketch #56a (cont.) Inverter-based renewable generation for up to and including 20% of the load center bus bar rating for meter base size ≤ 200 amps, for ≤ 240V installations**

**NOTES:**

- A. SEE PPL EU CUSTOMER-OWNED GENERATION WEBSITE FOR MORE INFORMATION.
- B. APPLICATION FOR CUSTOMER-OWNED, INVERTER-BASED RENEWABLE GENERATION MUST BE COMPLETED. SEE CUSTOMER-OWNED GENERATION APPLICATIONS.
- C. PPL EU REQUIRES AN INDEPENDENT ELECTRICAL INSPECTION. THE INSPECTOR IS REQUIRED TO VERIFY THE IEEE/UL LISTING OF THE INVERTER.
- D. INSTALLATION MUST ADHERE TO REQUIREMENTS OF NATIONAL ELECTRICAL CODE ARTICLE 690 AND ARTICLE 705.
- E. ALL LABELING MUST BE IN ACCORDANCE WITH NEC ARTICLE 690.
- F. IN ADDITION TO NOTE D, PPL EU WILL INSTALL PERMANENT LABELING ON THE METER BASE (PPL EU CATALOG CID 1012171) AND PAD MOUNT TRANSFORMER (CID 1012171) OR POLE MOUNT TRANSFORMER (CID 1013816) UPON RECEIPT OF INSPECTION.
- G. IF A NEUTRAL CONNECTION EXISTS AT THE INVERTER, THE INVERTER NEUTRAL SHALL BE CONNECTED TO THE SERVICE NEUTRAL.
- H. CUSTOMER SHALL CONTACT PPL EU PRIOR TO ANY NEW INSTALLATIONS DEPICTED IN THIS SKETCH.
- I. **PPL REQUIRES A LOCAL RS-485 OR ETHERNET COMMUNICATION INTERFACE, ALSO REFERRED TO AS A COMMUNICATION PORT, TO BE OPEN AND ACCESSIBLE FOR THE COMPANY OWNED DER MANAGEMENT DEVICE (IEEE 1547-2018, SEC. 10.1,4).**
- J. **INSTALLATIONS WITH MULTIPLE INVERTERS SHALL BE NETWORKED TOGETHER BY THE CUSTOMER PER MANUFACTURER GUIDELINES OR RS-485 MULTIDROP NETWORKING. A COMMUNICATION NETWORK DIAGRAM DEPICTING PORT AVAILABILITY AND NETWORKING DESIGN SHALL BE INCLUDED WITH THE SYSTEM'S INTERCONNECTION APPLICATION.**
- K. **FOR INVERTERS WHERE AN ADDITIONAL MODULE OR KIT IS REQUIRED TO MAKE THE COMMUNICATION INTERFACE/PORT AVAILABLE, THE MODULE OR KIT MUST BE INCLUDED AS PART OF THE INSTALLED SYSTEM. REFERENCE PPL'S APPROVED SOLAR INVERTER LIST FOR SPECIFIC INFORMATION.**
- L. **IN THE EVENT OF AN OUTAGE OR INTERRUPTION DUE TO EQUIPMENT FAILURE, WEATHER, ETC., ANY CONNECTED DER SYSTEMS MAY BE TEMPORARILY INTERRUPTED DURING THE SERVICE RESTORATION PROCESS.**

REMSI\_S056a.dwg

<p>RULES FOR ELECTRIC METER AND SERVICE INSTALLATIONS PPL ELECTRIC UTILITIES CORPORATION</p>	<p><b>Rules:</b> 12, 28 <b>Date:</b> 10/11/2021 Engr: NHK</p>
--	---