SKETCH #1 SHEET 1 SKETCH #1

SHEET 1



 NEW SERVICE DROP AND MAKES CONNECTION TO CUSTOMER'S SERVICE ENTRANCE CONDUCTORS. MAXIMUM TENSION - 700 LBS.

2. METER.

PPL EU FURNISHES, MAINTAINS; CUSTOMER INSTALLS:

3. SERVICE BRACKET.




CUSTOMER FURNISHES, INSTALLS, MAINTAINS:

- 4. SERVICE ENTRANCE CONDUCTORS, SEE RULE 5.
- METER BASE, SEE TABLE 1 FOR LIST OF APPROVED DEVICES.

NOTES:

- A. SEE RULE 4 AND 4A FOR CLEARANCES.
- B. 36 INCHES MINIMUM CLEARANCE IN ANY DIRECTION FROM THE OUTSIDE PERIMETER OF BUILDING OPENINGS, SUCH AS WINDOWS, DOORS, PORCHES, DECKS, BALCONIES, FIRE ESCAPES, OR SIMILAR. EXCEPTION SEE NOTE C.
- C. LESS THAN 36 INCHES PERMITTED WHEN SERVICE DROPS OR DRIP LOOPS ARE LOCATED OUT OF REACH ABOVE THE TOP LEVEL OF A WINDOW OR THE WINDOW IS DESIGNED NOT TO BE OPENED.
- D. METERBASE MUST BE SECURELY MOUNTED TO 2" NOMINAL LUMBER OR MASONRY CONSTRUCTION.
- E. 50" MINIMUM CLEAR SPACE IN FRONT OF METERBASE. SEE RULE 13, SKETCH 55 AND SKETCH 55A (SIDE VIEW).

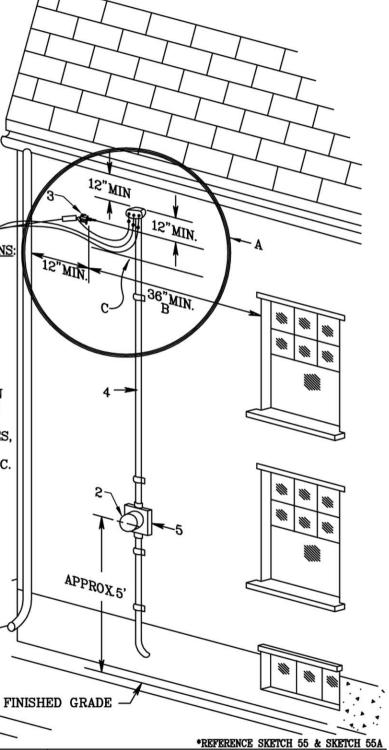

RULES FOR ELECTRIC METER AND SERVICE INSTALLATIONS

PPL ELECTRIC UTILITIES CORPORATION

Rules: 4, 4A, 5, 13

REMSI_S001_R1.dwg

Date: 8/17/07 Engr: MDB