




REMSI Sketches 1-25
Sketch #6
6-50

0000-000-ST-6050
 Custom ID: DCS 6-50
 Revision: 01
 Effective Date: 09/19/2016
 Page 16 of 69

Sketch #6 Overhead secondary service drop attachment to customer-owned service and meter pole to underground service entrance

Single phase or Three Phase, 240 volt maximum, self-contained meter, 600 ampere maximum

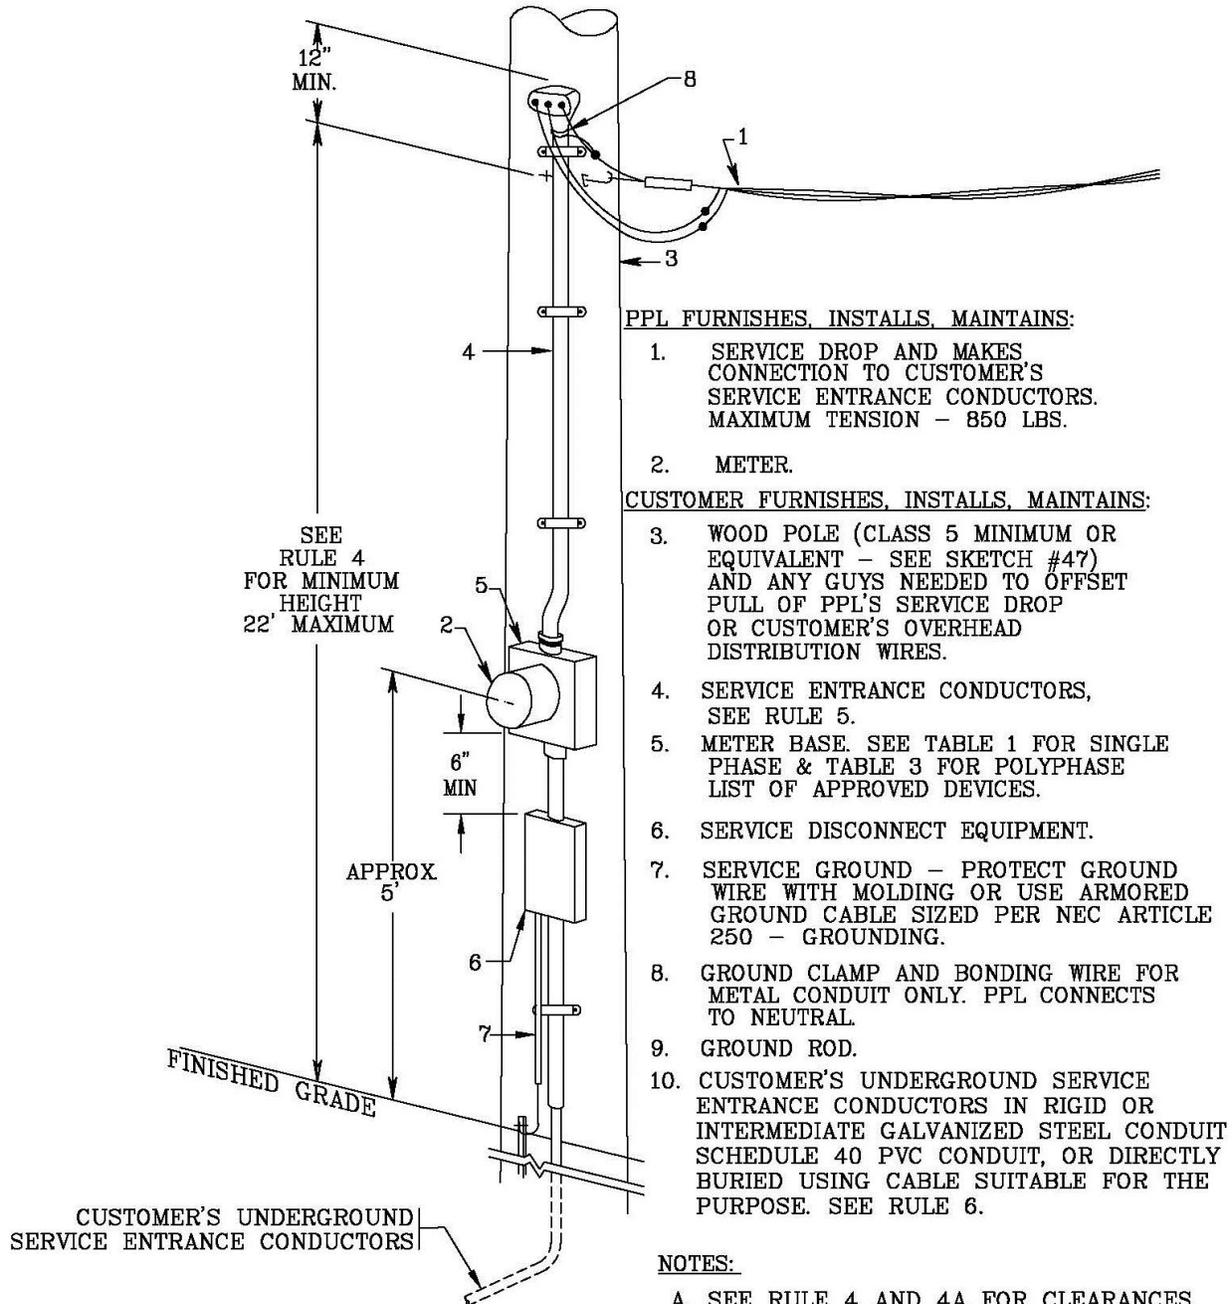

<p>RULES FOR ELECTRIC METER AND SERVICE INSTALLATIONS PPL ELECTRIC UTILITIES CORPORATION</p>	<p>Rules: 4, 4A, 5, 6</p> <p>Date: 7/18/16 Engr: NAP</p> <p style="text-align: right;">REMSI_S006_R2.dwg</p>
--	---